



**LESS THAN 1 AMP OF CURRENT IS NEEDED TO PROVIDE POWER TO TIMER AND DIMMERS. CAN BE PULLED FROM LOCAL POWER SOURCE OR DEDICATED CIRCUIT.**

**1 DIMMER CONTROLLING 2 RELAYS**

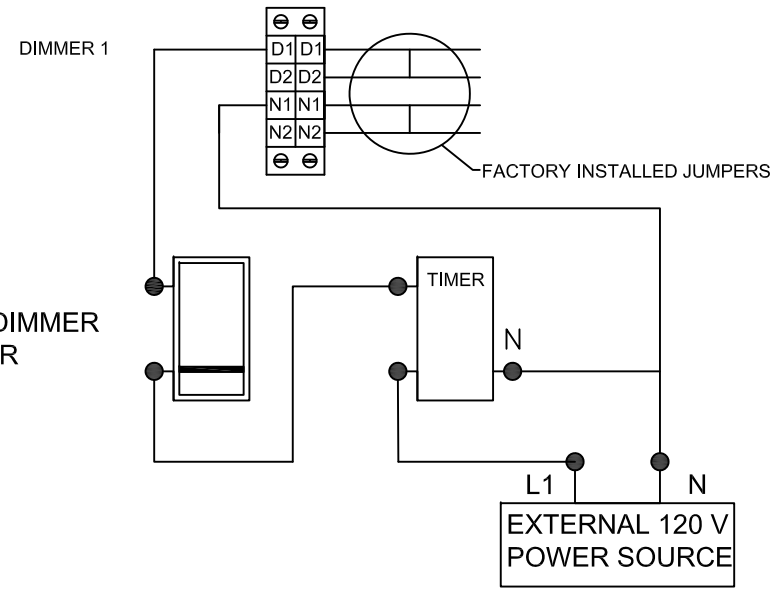

0-120VAC DIMMER WITH TIMER

**1 DIMMER PER RELAY**

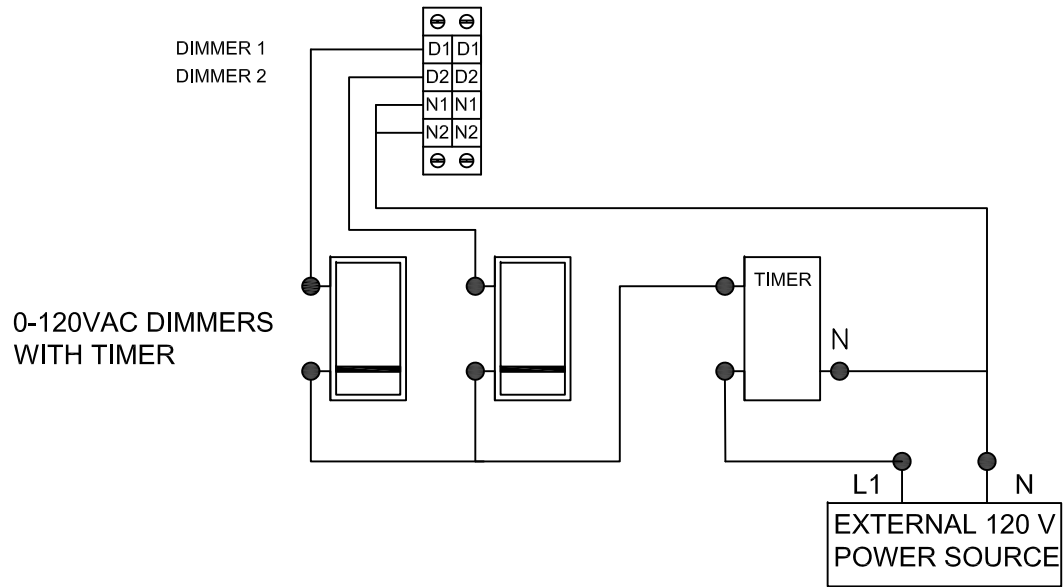

0-120VAC DIMMERS WITH TIMER

**NOTE: ALL INFRATECH PRODUCTS MUST BE INSTALLED BY A LICENSED ELECTRICIAN**

		15700 S. Figueroa St. Gardena, California 90248 Phone: (310) 354-1250 Fax: (310) 523-3674	
		www.infratech-usa.com	
DESCRIPTION			
DIMMER AND TIMER WIRING EXAMPLES			
DATE	ITEM#	N/A	
Dec. 16 2019	DRAWN BY:	CL	